



Advanced Technology. Simple Solutions.

ROOF-TOP PEDESTAL

RTP



Rule 26-710 of the 2018 CEC states that receptacles are required for maintenance of equipment located on roof-tops. This easy-to-install all-encompassing roof-top pedestal exceeds the requirements of the standard.

Features / Specifications

- Galvanized steel construction
- CSA Type 3R rated
- Heavy-duty while-in-use flip-lid cover
- 34 in. high, for mounting on solid bases
- Pad-mount base standard
- Commercial-grade receptacles
- PC101 Grey powder coat finish
- Ground lug

Code Requirements

- GFCI receptacle
- Supplied by a separate branch circuit that does not supply any other outlets or equipment
- CSA configuration 5-20R (120V 20A T Slot Receptacle)
- Located within 7.5 m of roof-top electrical equipment
- Not less than 750 mm (29.5 in.) above the finished roof
- Protected from mechanical damage

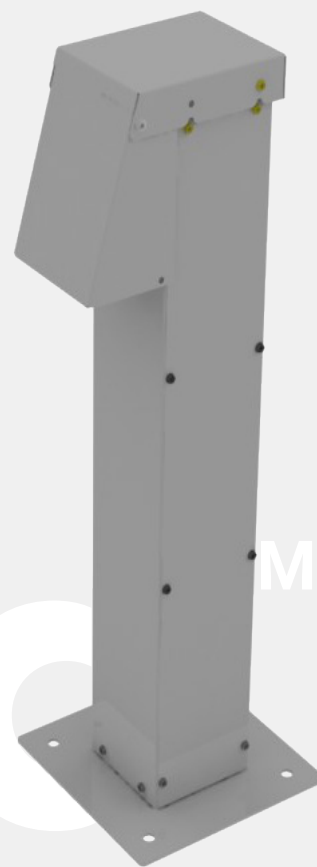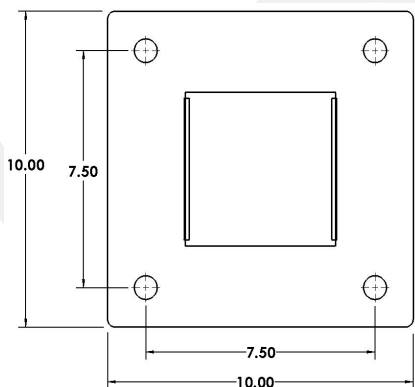

PART NUMBER	RECEPTACLES	CONFIGURATION
RTP-GFI-20	1 - 20A GFI	SINGLE-SIDED